
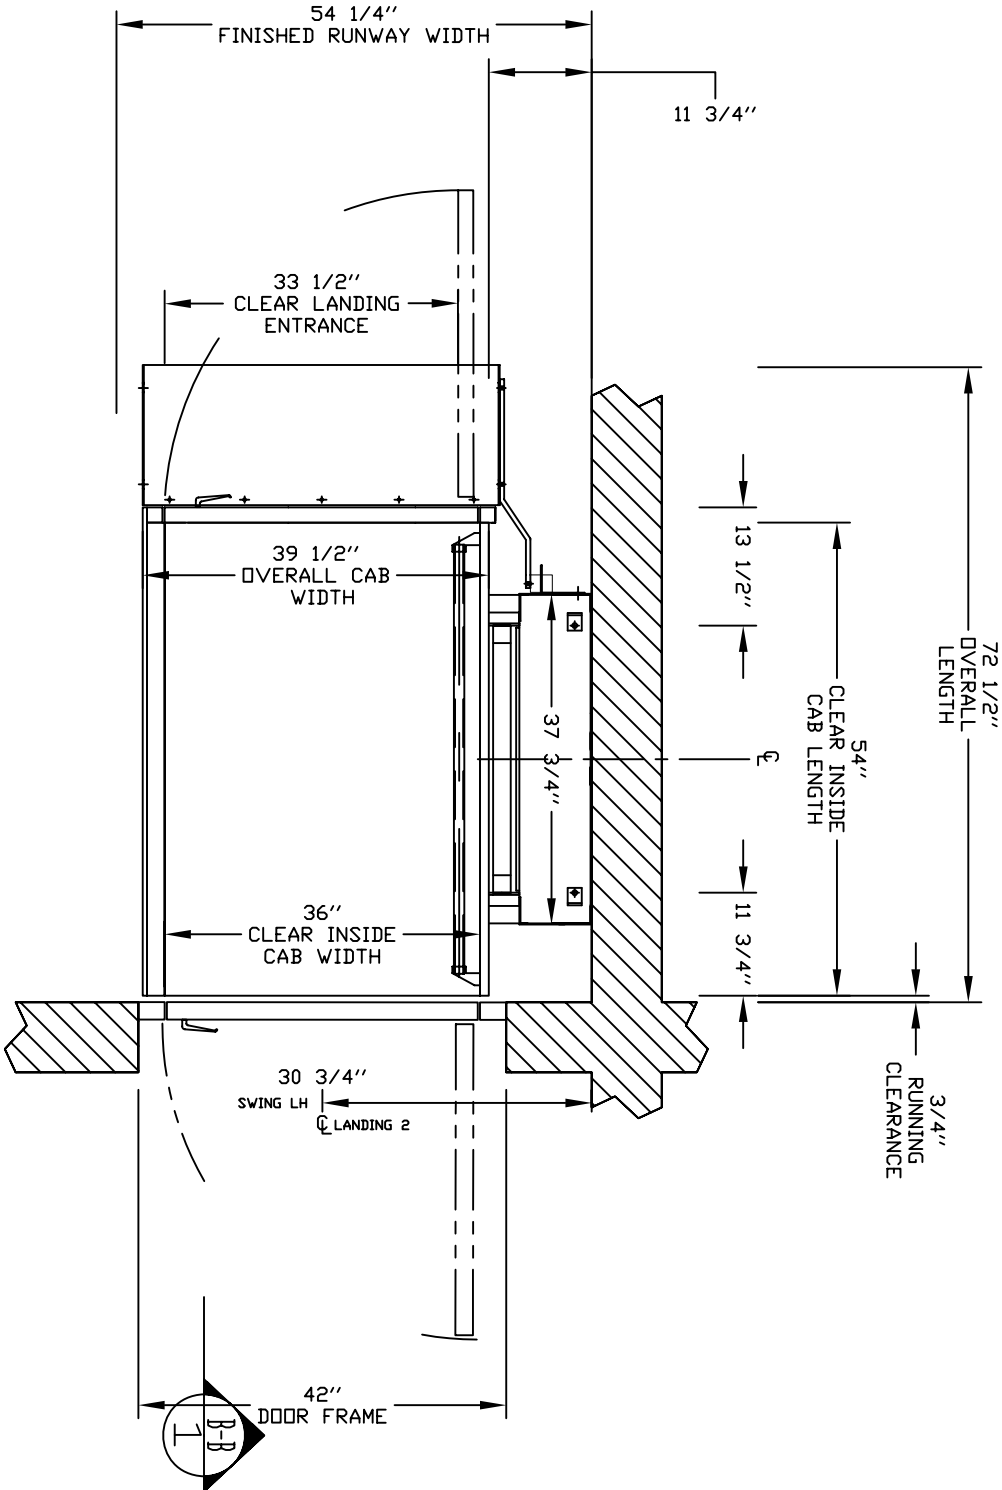


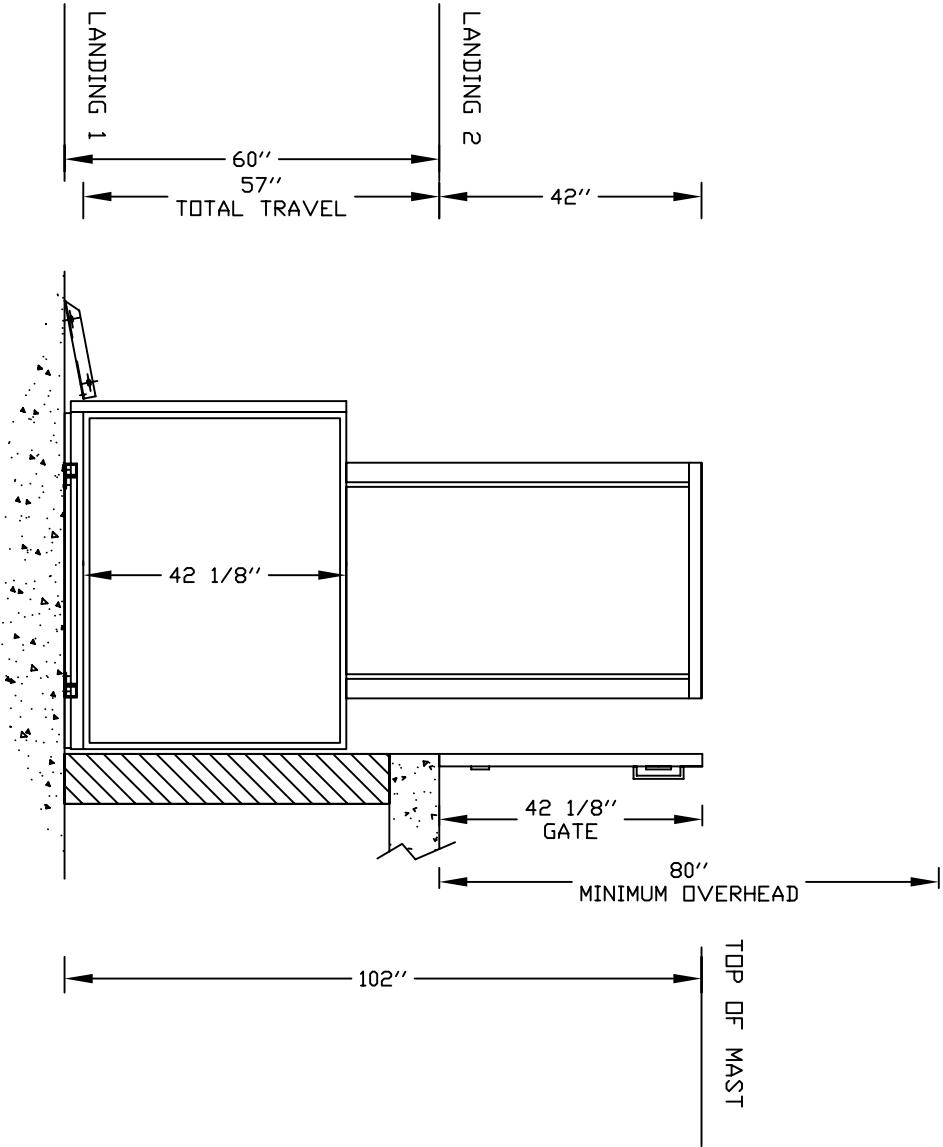

PRELIMINARY DRAWING ONLY
DRAWING APPROVAL:

THIS DRAWING REFLECTS OUR INTERPRETATION OF THE INFORMATION PROVIDED BY THE DEALER ON THE ORDER FORM. THIS INFORMATION IS THE DEALER'S RESPONSIBILITY, AND IS THE BASIS FROM WHICH THIS LIFT IS DESIGNED AND MANUFACTURED. PLEASE INDICATE THE REQUESTED ACTION BY CHECKING ONE OF THE FOLLOWING BOXES AND SIGNING BELOW TO AUTHORIZE COMPLETION OF THIS ORDER.

- ☐ APPROVED WITH NO EXCEPTIONS
MANUFACTURE PRODUCT AS PER DRAWING
- ☐ APPROVED WITH EXCEPTIONS, NO REAPPROVAL
REQUIRED
MAKE CHANGES AS NOTED, NO REAPPROVAL DRAWING REQUIRED
- ☐ CHANGE AS NOTED, REAPPROVAL REQUIRED
MAKE CHANGES AS NOTED, SEND CORRECTED DRAWING FOR
REAPPROVAL BEFORE MANUFACTURE

CHANGES REQUEST:

1. _____
2. _____
3. _____
4. _____

SIGNATURE: _____ DATE: _____

CAUTION: ONCE THE DRAWING IS APPROVED, JOB CANCELLATION FEES WILL APPLY

GENERAL ARRANGEMENT
VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER:	NATIONWIDE LIFTS		
PROJECT:	APEX GREEN - 36 WIDE X 54 DEEP		
ADDRESS:	DOORS OPPOSITE SIDES, RAILS ON LEFT		
	888-323-8755 INFO@ELEVATORS.COM		

OFFICE USE ONLY:	
CONFIGURATION VERSION STAMP:	0.0
MODULE VERSION STAMP:	M-S-42.7

Port No.	48575		
Variant No.	P-0000001		
DATE:	06/16/15		
REVISION DATE:	06/17/15		
COMPLETED BY:	A		
SHEET No. 1 OF 3			

Nationwide Lifts
www.elevators.com

savarria™

PROVISIONS BY OTHERS

GENERAL

HOISTWAY – THE HOISTWAY MUST BE DESIGNED AND BUILT IN ACCORDANCE WITH ‘SAFETY STANDARD FOR PLATFORM LIFTS AND STAIRWAY CHAIRLIFTS’ OR ‘SAFETY CODE FOR ELEVATORS AND ESCALATORS’ AND ALL STATE AND LOCAL CODES.

PLUMB RUNWAY– DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB (-/+ 1/8” (3 mm)) AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.

MINIMUM OVERHEAD CLEARANCE– OWNER/AGENT MUST ENSURE MINIMUM OVERHEAD CLEARANCE IS IN COMPLIANCE WITH CODES.

CONSTRUCTION SITE– OWNER/AGENT TO PROVIDE ALL MASONRY, CARPENTRY AND DRYWALL WORK AS REQUIRED AND SHALL PATCH AND MAKE GOOD (INCLUDING FINISH PAINTING) ALL AREAS WHERE WALLS/FLOORS MAY REQUIRE TO BE CUT, DRILLED OR ALTERED IN ANY WAY TO PERMIT THE PROPER INSTALLATION OF THE LIFT.

DIMENSIONS– CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

STRUCTURAL

FLOOR/SUPPORT WALL LOADS–STRUCTURE TO ANCHOR A CRANK SHAFT AND SAFETY HARNESS, WHERE APPLICABLE/ NEEDED, TO BE PROVIDED BY CONTRACTOR.

CONTRACTOR TO ASSURE THAT BUILDING AND SHAFT WILL SAFELY SUPPORT ALL LOADS IMPOSED BY THE LIFT EQUIPMENT. REFER TO THE LOAD DIAGRAM ON THIS DRAWING. MAST TO BE SECURELY FASTENED– WHERE REQUIRED THE MAST MUST BE SECURELY FASTENED TO THE STRUCTURAL SUPPORT FLOOR. REFER TO FLOOR SUPPORT LOAD DIAGRAM AND ANCHOR DIMENSIONS ON THIS DRAWING. NO WALL LOADS SINCE THIS UNIT CAN ONLY BE FREE STANDING.

WHERE DOORS ARE REQUIRED– SUITABLE LINTELS MUST BE PROVIDED BY OWNER/AGENT. DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS.

ELECTRICAL

GENERAL– ELECTRICAL EQUIPMENT AND WIRING TO COMPLY WITH SECTION 38 OF CSA C22.1 (CANADA) OR SECTION 620 OF NEC ANSI/NFPA 70 (USA).

POWER SUPPLY–120VAC, 20A, 60HZ, 1PH CIRCUIT THROUGH A FUSE DISCONNECT WITH AUXILIARY CONTACT ON MAIN POWER SUPPLY. PROVIDE TWO 18 AWG CONDUCTORS BETWEEN CONTACT AND CONTROLLER.

LIGHTING–LIGHTING OF 100 LX MIN. AT PLATFORM AND LANDINGS. LIGHTING WITH SWITCH AND ELECTRICAL GFCI OUTLET IN HOISTWAY PIT.

PHONE– NEED A DEDICATED PHONE LAND LINE (NOT VOIP) FOR THE PHONE, WHERE APPLICABLE. FOR VOIP PLEASE CONTACT SAVARIA.

ENTRANCES

UPPER LANDING GATES– WHERE REQUIRED, SMOOTH SOLID BARRIERS ARE TO BE SUPPLIED AND INSTALLED ON BOTH SIDES OF ENTRANCE AT UPPER LEVEL AND MUST BE A MINIMUM OF 42” (1067 mm) HIGH. ENTRANCE ASSEMBLY MUST BE IN PLACE PRIOR TO THIS PROVISION.

FASCIA PANEL BELOW UPPER LEVEL ENTRANCE– WHERE REQUIRED, FASCIA PANEL MUST BE FASTENED TO A SOLID WALL AND BE PERPENDICULAR TO THE FLOOR AND WALLS.

HOISTWAY FASCIA IS NOT SELF-SUPPORTING FOR LONG, CONTINUOUS RUNS VOID OF ENTRANCES. ADEQUATE SUPPORT FOR THE FASCIA MUST BE PROVIDED.

ENTRANCE ASSEMBLIES– ENTRANCE ASSEMBLIES MUST BE ADJUSTED TO ALIGN WITH PLATFORM AND INTERLOCK EQUIPMENT. OTHERS TO ALLOW AN ADEQUATE ROUGH OPENING.

RETURN WALLS– RETURN WALLS AT ENTRANCES MUST BE BUILT-IN BY OTHERS AFTER ENTRANCE ASSEMBLIES ARE IN PLACE. ENTRANCE ASSEMBLY MUST BE SECURELY FASTENED TO WALLS.

SPECIFICATIONS

GENERAL

CLASSIFICATION: Vertical Wheelchair Platform Lift
APPLIED CODE: ASME A18.1,Section 2 (Public)
MODEL: Multilift

CAPACITY: 750 lbs (340 kg)
SPEED: 8’/min (0.04 m/s)
TRAVEL: 57” (1448 mm)

PIT DEPTH: 0” (0 mm)
PLATFORM SIZE: 36” X 54” (914 mm X 1372 mm)
POWER SUPPLY: 110V,15A,60Hz,SINGLE PHASE
BATTERY BACK UP: No
SUSPENSION: ACME SCREW 25mm

CONTROLLER


MODEL: MULTILIFT
TYPE: CPFS
ETL #: 94307
CONTROL VOLTS: 24VAC/12VDC
CONTROL AMPS: 1 A
AMPS: 15
MFR.: SAVARIA

POWER UNIT

MOTOR: 0.75 HP, 110/115 VAC



DOORS / GATES / CALL STATIONS

LANDING 1		LANDING 2	
Platform Gate	42" High Upper Lndg Gate		
a	c		
rh	lh		
Steel Panel	Steel Panel		
WR500 Lock (24V)	WR500 Lock (24V)		
Not Applicable	Not Applicable		
no	yes		
Call/Stn. Type	Call/Send 2 Buttons		
Call Stn. Ke'd	Not Required		
Call Stn. Stop Button	Not Required		
Call Stn. Mounting	Flush Mount		
Isolated Proddor Kit	No		

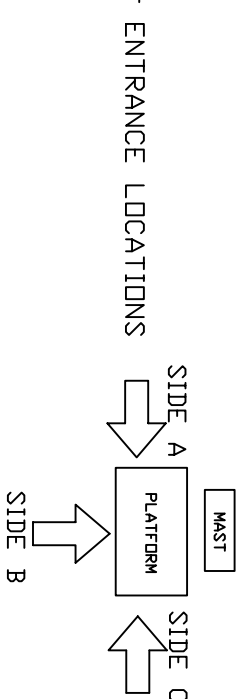

OPTIONS PROVIDED

TOUCH UP PAINT:	1 can(s)	RAMP:	Auto Ramp
BUILDING:	Public Building	EXTRA KEYS:	
UNDERPAN SENSOR:	yes	SAFETY PINS/BLOCKS:	no
COLOR:	yes	MANUAL LOWERING DEVICE:	yes
EXTERIOR UNIT :	yes	PIT SWITCH:	yes

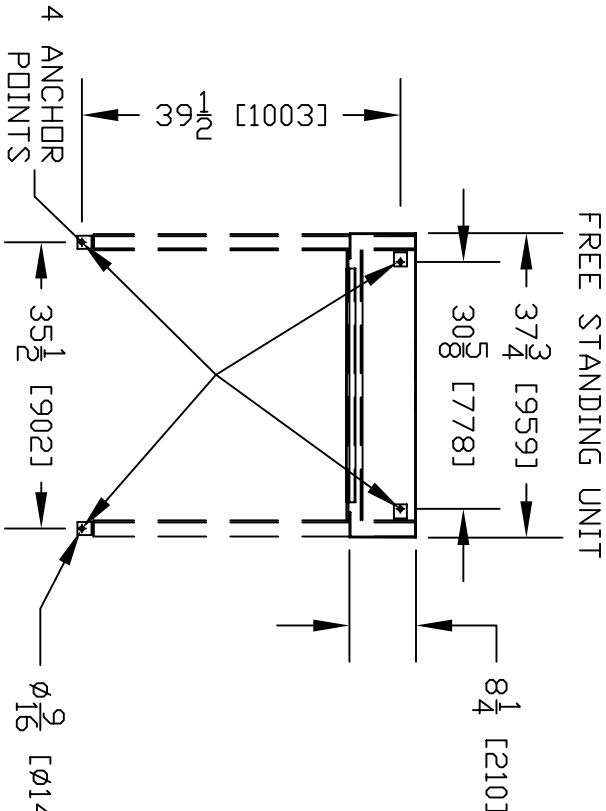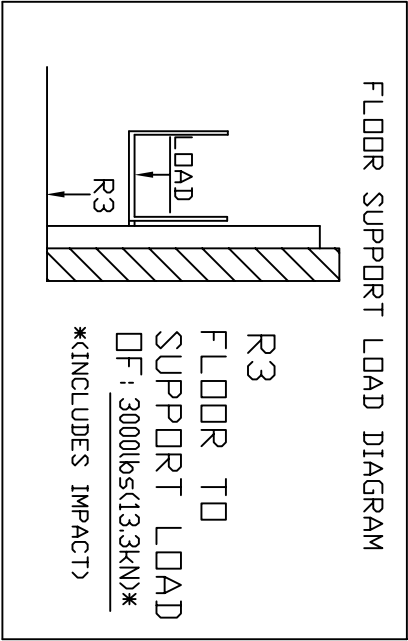

DATA SHEET

CUSTOMER:	NATIONWIDE LIFTS		
PROJECT:	APEX GREEN – 36 WIDE X 54 DEEP		
ADDRESS:	DOORS OPPOSITE SIDES, RAILS ON LEFT		
	888-323-8755	INFO@ELEVATORS.COM	

Port No.	48575		
Variant No.	P-0000002 OF 3		
Nationwide Lifts www.elevators.com			
savaria™			
JOB No.	P-0000002 OF 3		
SHEET No.		2 OF 3	

NOTES:


A: DRYWALL OR PARGING (BY OTHERS) AS REQ'D.

B: SEE DATASHEET OF THE INSTALLATION DRAWING FOR LANDING ENTRANCE SCHEDULE.


C: ALL INFORMATION IS SUBJECT TO CHANGE.

GENERAL INFORMATIONS:


- EACH HANDING ENTRANCE SHALL BE SUPPLIED AS A FINISHED ASSEMBLY WITH GATE AND FRAME BLANED, REINFORCED, DRILLED AND TAPPED FOR ALL COMPONENTS DETAILED, READY FOR INSTALLATION.
- DIFFERENT PANEL INSERT MATERIALS ARE OPTIONAL.
- DIFFERENT LOCKS SUCH AS GAL. OR WR500 ARE OPTIONAL.
- MANUAL GATE: HYDRAULIC DOOR CLOSER IS PROVIDED.

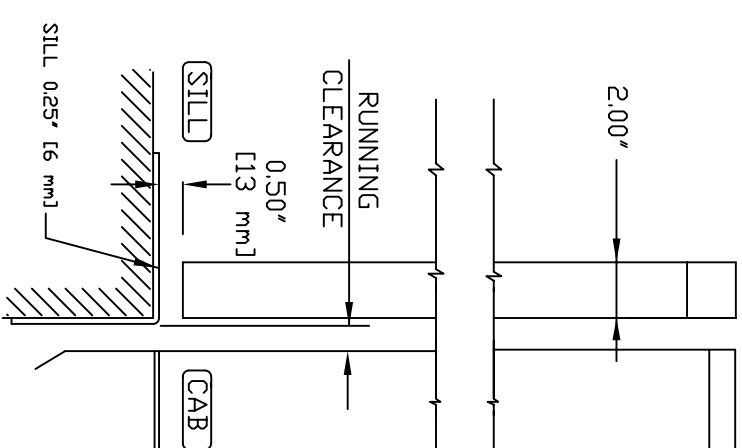


VERTICAL SECTION

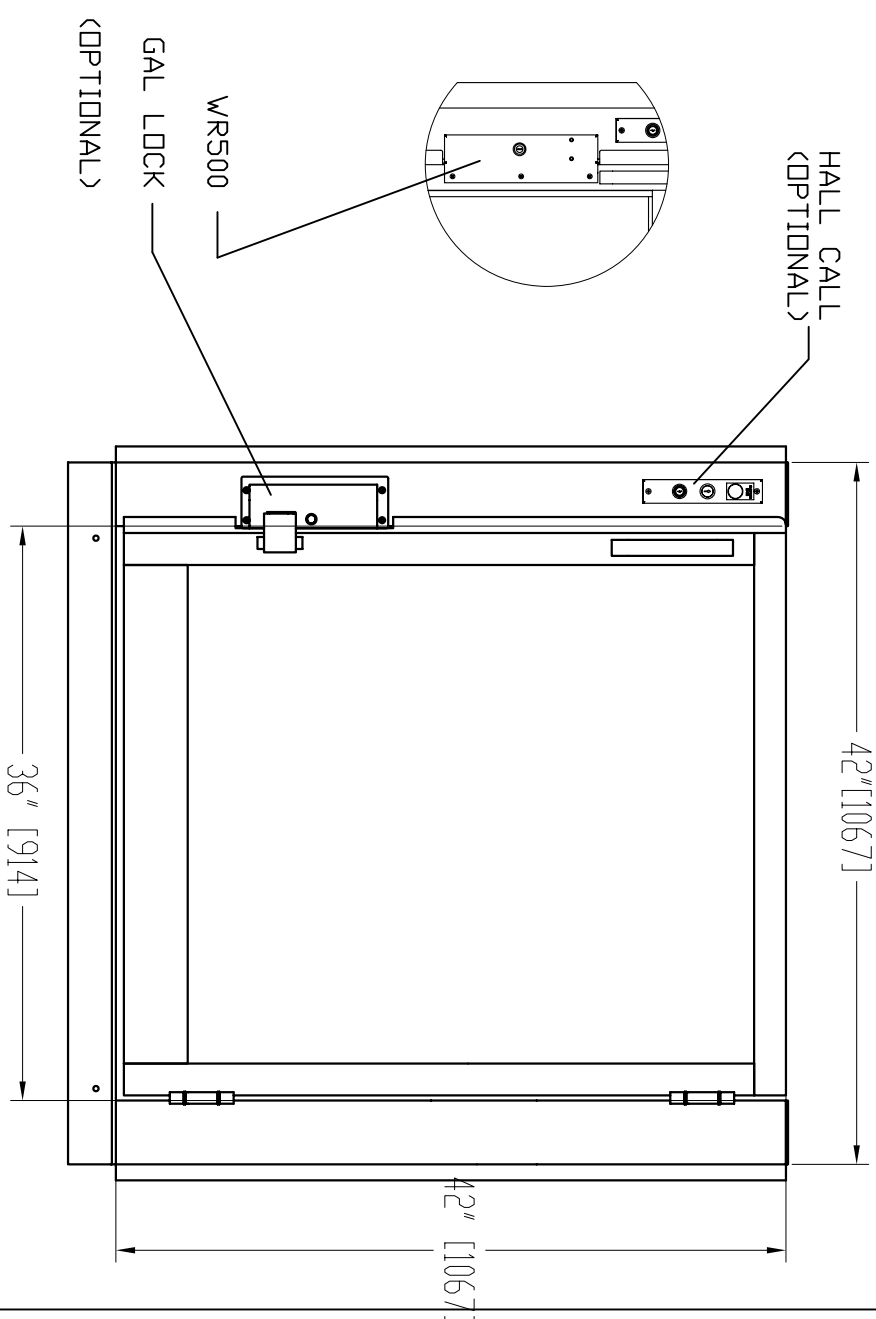

SIDE VIEW

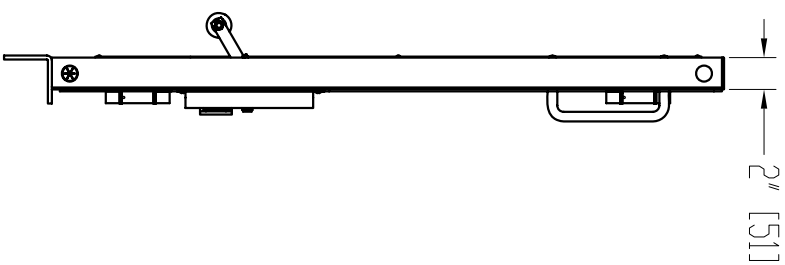

FRONT VIEW



WALL ATTACHMENT
(8X) #8 X 3 FH SCREWS
(SHIM AS REQUIRED)







Diagram illustrating a screw on a wall. The screw is shown at an angle, with the label "ANGLE STILL: SCREW ON WALL" indicating its orientation.

HORIZONTAL SECTION

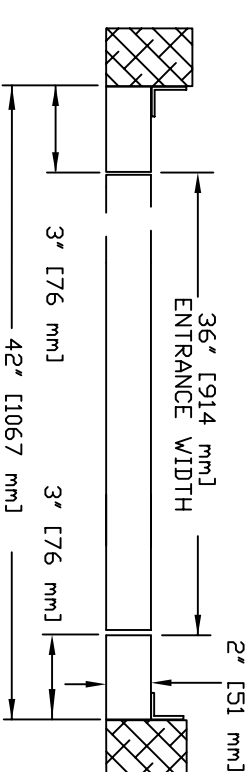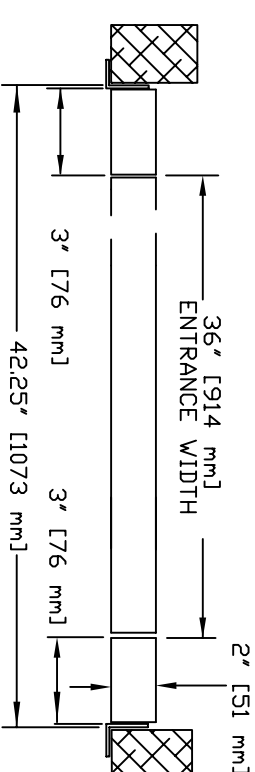

Second Level Door



LEFT HAND SWING

VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER:	NTITION WIDE LEFTS	DATE:	06/16/15
PROJECT:	APEX GREEN - 36 WIDE X 54 DEEP	REVISION DATE:	06/17/15
ADDRESS:	DOORS OPPOSITE SIDES, RAILS ON LEFT 888-323-8755 INFO@ELEVATORS.COM	COMPLETED BY:	ANDREA CRIVELLO
			7

Part No.	
Variant No.	4 8 5 7 5
 Nationwide Lifts www.elevators.com	
	
JOB NO.	P-0000000
SHEET NO.	3 OF 3