
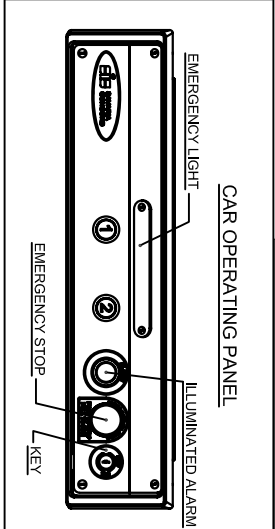


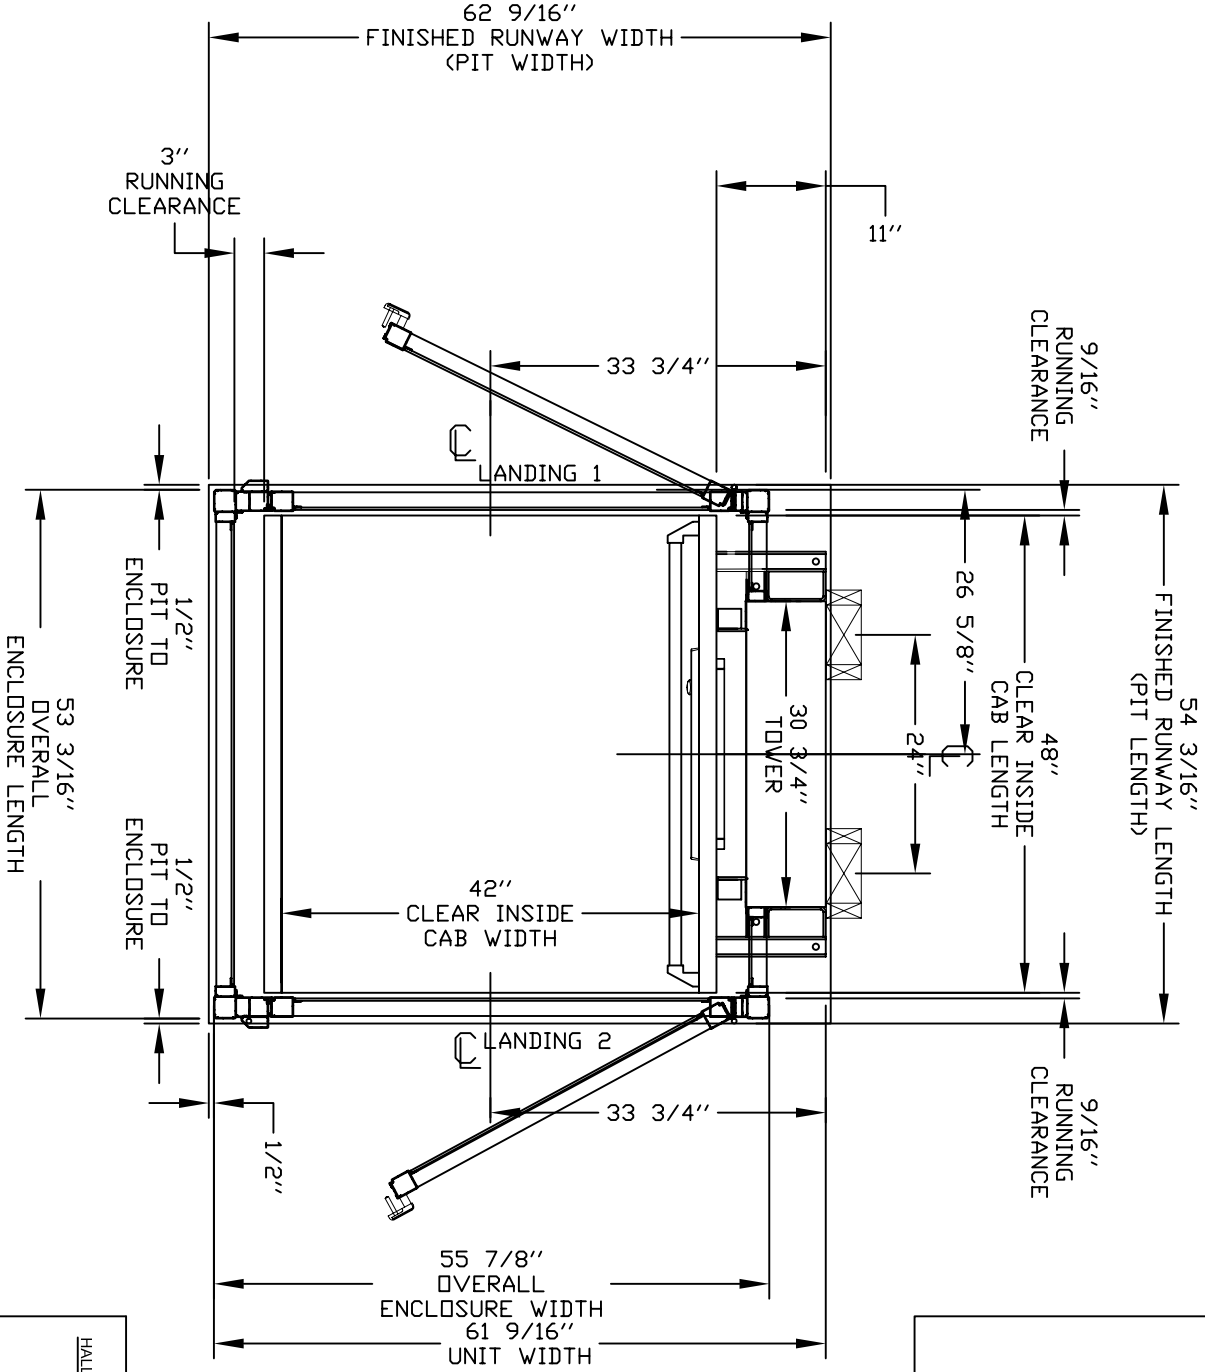


TYPICAL PLAN

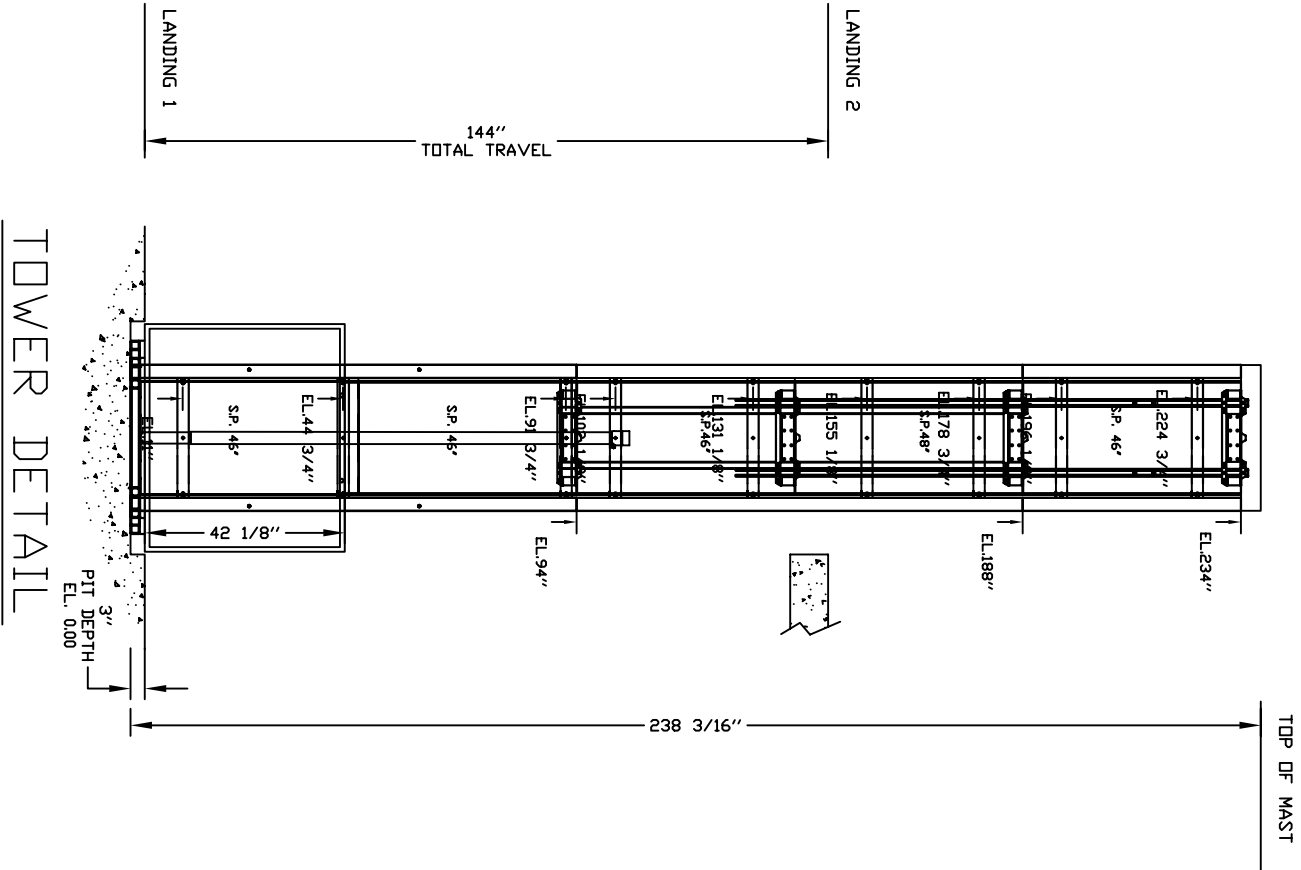

PRELIMINARY DRAWING ONLY
DRAWING APPROVAL:

THIS DRAWING REFLECTS OUR INTERPRETATION OF THE INFORMATION PROVIDED BY THE DEALER ON THE ORDER FORM. THIS INFORMATION IS THE DEALER'S RESPONSIBILITY, AND IS THE BASIS FROM WHICH THIS LIFT IS DESIGNED AND MANUFACTURED. PLEASE INDICATE THE REQUESTED ACTION BY CHECKING ONE OF THE FOLLOWING BOXES AND SIGNING BELOW TO AUTHORIZE COMPLETION OF THIS ORDER.

☐ APPROVED WITH NO EXCEPTIONS
MANUFACTURE PRODUCT AS PER DRAWING

☐ APPROVED WITH EXCEPTIONS, NO REAPPROVAL REQUIRED
MAKE CHANGES AS NOTED. NO REAPPROVAL DRAWING REQUIRED

☐ CHANGE AS NOTED, REAPPROVAL REQUIRED
MAKE CHANGES AS NOTED, SEND CORRECTED DRAWING FOR REAPPROVAL BEFORE MANUFACTURE

CHANGES REQUEST:

1. _____

2. _____

3. _____

4. _____

SIGNATURE: _____ DATE: _____

CAUTION: ONCE THE DRAWING IS APPROVED, JOB CANCELLATION FEES WILL APPLY

OFFICE USE ONLY:	
CONFIGURATION VERSION STAMP:	0.0
MODULE VERSION STAMP:	15743

Port No.	Variant No.
	48571

Nationwide Lifts
www.elevators.com

GENERAL ARRANGEMENT
ENCLOSED VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER:	NA TIONWIDE LIFTS
PROJECT:	APEX COMPLETE - 42 WIDE X 48 DEEP
ADDRESS:	DOORS OPPOSITE SIDES, RAILS ON LEFT
	888-323-8755 INFO@ELEVATORS.COM

DATE:	06/16/15
REVISION DATE:	06/16/15
COMPLETED BY:	ANDREW HALL
JOB No.	P000001
SHEET No.	1 OF 4

savarida



PROVISIONS BY OTHERS

GENERAL

HOISTWAY – THE HOISTWAY MUST BE DESIGNED AND BUILT IN ACCORDANCE WITH ‘SAFETY STANDARD FOR PLATFORM LIFTS AND STAIRWAY CHAIRLIFTS’ OR ‘SAFETY CODE FOR ELEVATORS AND ESCALATORS’ AND ALL STATE AND LOCAL CODES.

PLUMB RUNWAY– DUE TO CLOSE RUNNING CLEARANCES OWNER/ AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB (-/+ 1/8” (3 mm)) AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.

MINIMUM OVERHEAD CLEARANCE– OWNER/AGENT MUST ENSURE MINIMUM OVERHEAD CLEARANCE IS IN COMPLIANCE WITH CODES.

CONSTRUCTION SITE– OWNER/AGENT TO PROVIDE ALL MASONRY, CARPENTRY AND DRYWALL WORK AS REQUIRED AND SHALL PATCH AND MAKE GOOD (INCLUDING FINISH PAINTING) ALL AREAS WHERE WALLS/FLOORS MAY REQUIRE TO BE CUT, DRILLED OR ALTERED IN ANY WAY TO PERMIT THE PROPER INSTALLATION OF THE LIFT.

DIMENSIONS– CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

STRUCTURAL

FLOOR/SUPPORT WALL LOADS– CONTRACTOR TO ASSURE THAT BUILDING AND SHAFT WILL SAFELY SUPPORT ALL LOADS IMPOSED BY THE LIFT EQUIPMENT. REFER TO THE LOAD DIAGRAM ON THIS DRAWING.

MAST TO BE SECURELY FASTENED– WHERE REQUIRED THE MAST MUST BE SECURELY FASTENED TO THE STRUCTURAL SUPPORT WALL. REFER TO WALL / FLOOR SUPPORT LOAD DIAGRAM AND WALL LAG DIMENSIONS ON THIS DRAWING.

WHERE DOORS ARE REQUIRED– SUITABLE LINTELS MUST BE PROVIDED BY OWNER/AGENT. DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS.

ELECTRICAL

GENERAL– ELECTRICAL EQUIPMENT AND WIRING TO COMPLY WITH SECTION 38 OF CSA C22.1 (CANADA) OR SECTION 620 OF NEC ANSI/NFPA 70 (USA).

POWER SUPPLY– 120VAC, 20A, 60HZ, 1PH CIRCUIT THROUGH A FUSE DISCONNECT WITH AUXILIARY CONTACT ON MAIN POWER SUPPLY. PROVIDE TWO 18 AWG CONDUCTORS BETWEEN CONTACT AND CONTROLLER.

LIGHTING–LIGHTING OF 100 LX MIN. AT PLATFORM AND LANDINGS. LIGHTING WITH SWITCH AND ELECTRICAL GFCI OUTLET IN HOISTWAY PIT.

ENTRANCES

UPPER LANDING GATES– WHERE REQUIRED, SMOOTH SOLID BARRIERS ARE TO BE SUPPLIED AND INSTALLED ON BOTH SIDES OF ENTRANCE AT UPPER LEVEL AND MUST BE A MINIMUM OF 42” (1067 mm) HIGH. ENTRANCE ASSEMBLY MUST BE IN PLACE PRIOR TO THIS PROVISION.

FASCIA PANEL BELOW UPPER LEVEL ENTRANCE– WHERE REQUIRED, FASCIA PANEL MUST BE FASTENED TO A SOLID WALL AND BE PERPENDICULAR TO THE FLOOR AND WALLS. HOISTWAY FASCIA IS NOT SELF-SUPPORTING FOR LONG, CONTINUOUS RUNS VOID OF ENTRANCES. ADEQUATE SUPPORT FOR THE FASCIA MUST BE PROVIDED.

ENTRANCE ASSEMBLIES– ENTRANCE ASSEMBLIES MUST BE ADJUSTED TO ALIGN WITH PLATFORM AND INTERLOCK EQUIPMENT.

OTHERS TO ALLOW AN ADEQUATE ROUGH OPENING.
RETURN WALLS– RETURN WALLS AT ENTRANCES MUST BE BUILT-IN BY OTHERS AFTER ENTRANCE ASSEMBLIES ARE IN PLACE. ENTRANCE ASSEMBLY MUST BE SECURELY FASTENED TO WALLS.

SPECIFICATIONS

GENERAL

CLASSIFICATION:
APPLIED CODE:
SPECIAL NOTE:
MODEL:
CAPACITY:
SPEED:
TRAVEL:
PIT DEPTH:
PLATFORM SIZE:
POWER SUPPLY:
BATTERY BACK UP:

Enclosed Vertical Wheelchair Platform Lift
ASME A18.1-2008 Section 2 Pub
V-1504 Enclosure
750 lbs (341 kg)
20 fpm (0.102 m/s)
144” (3658 mm)
3” (76 mm)
42” X 48” (1067 mm X 1219 mm)
120V,20A,60Hz,SINGLE PHASE
down direction only

JACK UNIT

STROKE:
PLUNGER O/D:
CYL. O/D:
CYL. I/D:

CONTROLLER

MODEL:
TYPE:
ETL #:
CONTROL VOLTS:
CONTROL AMPS:
H.P.:
AMPS:
MFR.:

POWER UNIT


MOTOR:
FLOW:
3.0 HP, 120 VAC
1.15 Gal/min (4.35L/min)

HYDRAULIC DATA

OIL TYPE:
GALLONS REQ'D:
MAXIMUM WORKING PRESSURE:
RELIEF PRESSURE:
MAXIMUM RELIEF PRESSURE:
HYDRAULIC HOSE:
BURST:
FITTINGS:
UNIVIS 32 INDOOR
DEXRON ATF OUTDOOR
1.5 Gal (5.68 L)
2000 psi (13.7 MPa)
WPx125% MAX.
2000 psi (13.7 MPa)
1/4” (6.4 mm) ID
20000 psi (137.9 MPa)
1/4” (6.4 mm) NPT MALE

SUSPENSION CHAIN

2X #50 ROLLER CHAIN
BREAKING STRENGTH:
SAFETY BRAKE:
7171 lbs (31.9 kN) each
TYPE ‘A’



MOUNTING BRACKET

DOORS / GATES / CALL STATIONS

	LANDING 1	LANDING 2	LANDING 3	LANDING 4
DOOR TYPE	Enclosure 80" Door	Enclosure 80" Door		
DOOR SWING	a	c		
DOOR INSERT	rh	lh		
LOCK TYPE	Clear Plexiglass WR500 Lock (24V)	Clear Plexiglass WR500 Lock (24V)		
AUTO DOOR OPENER	NO	NO		
CUSTOM DOOR WIDTH				
CUSTOM DOOR HEIGHT				
IN FRAME CALL STN.				
CALL STN. TYPE	no	yes		
CALL STN. KEVED				
CALL STN. STOP BUTTON				
CALL STN. MOUNTING	Call/Send Buttons Not Required	Call/Send Buttons Not Required		
ISOLATED PRODDOR KIT	Surface Mounted Remote	Flush Mounted In Frame		
	No	No		

OPTIONS PROVIDED

EMERGENCY PENDENT PLUG IN MANUAL LOWERING BOX
WINGS: no
TOUCH UP PAINT: 1 canks)
BUILDING: Public Building
LIGHT CURTAIN: no
PHONE OR PHONE PLUG: No Phone,Plug Incl
RAMP: No Ramp Required
EXTRA KEYS: 0
WALL FASTENERS: none
UNDERPAN SENSOR: no
COLOUR: Standard Color - Almond Beige

LOCATION: IN DOOR

OFFICE USE ONLY:	Port No.	Nationwide Lifts
CONFIGURATION VERSION STAMP:		www.elevators.com
MODULE VERSION STAMP:		

CUSTOMER:	DATE:	Variant No.	48571
PROJECT:	REVISION DATE:		
ADDRESS:	COMPLETED BY:		
ENCLOSED VERTICAL WHEELCHAIR PLATFORM LIFT			


DATA SHEET

ENCLOSED VERTICAL WHEELCHAIR PLATFORM LIFT

APX COMPLETE - 42 WIDE X 48 DEEP
DOORS OPPOSITE SIDES, RAILS ON LEFT
888-323-8755 INFO@ELEVATORS.COM

SAVARIA	SHEET No.	4

PANEL DRAWING

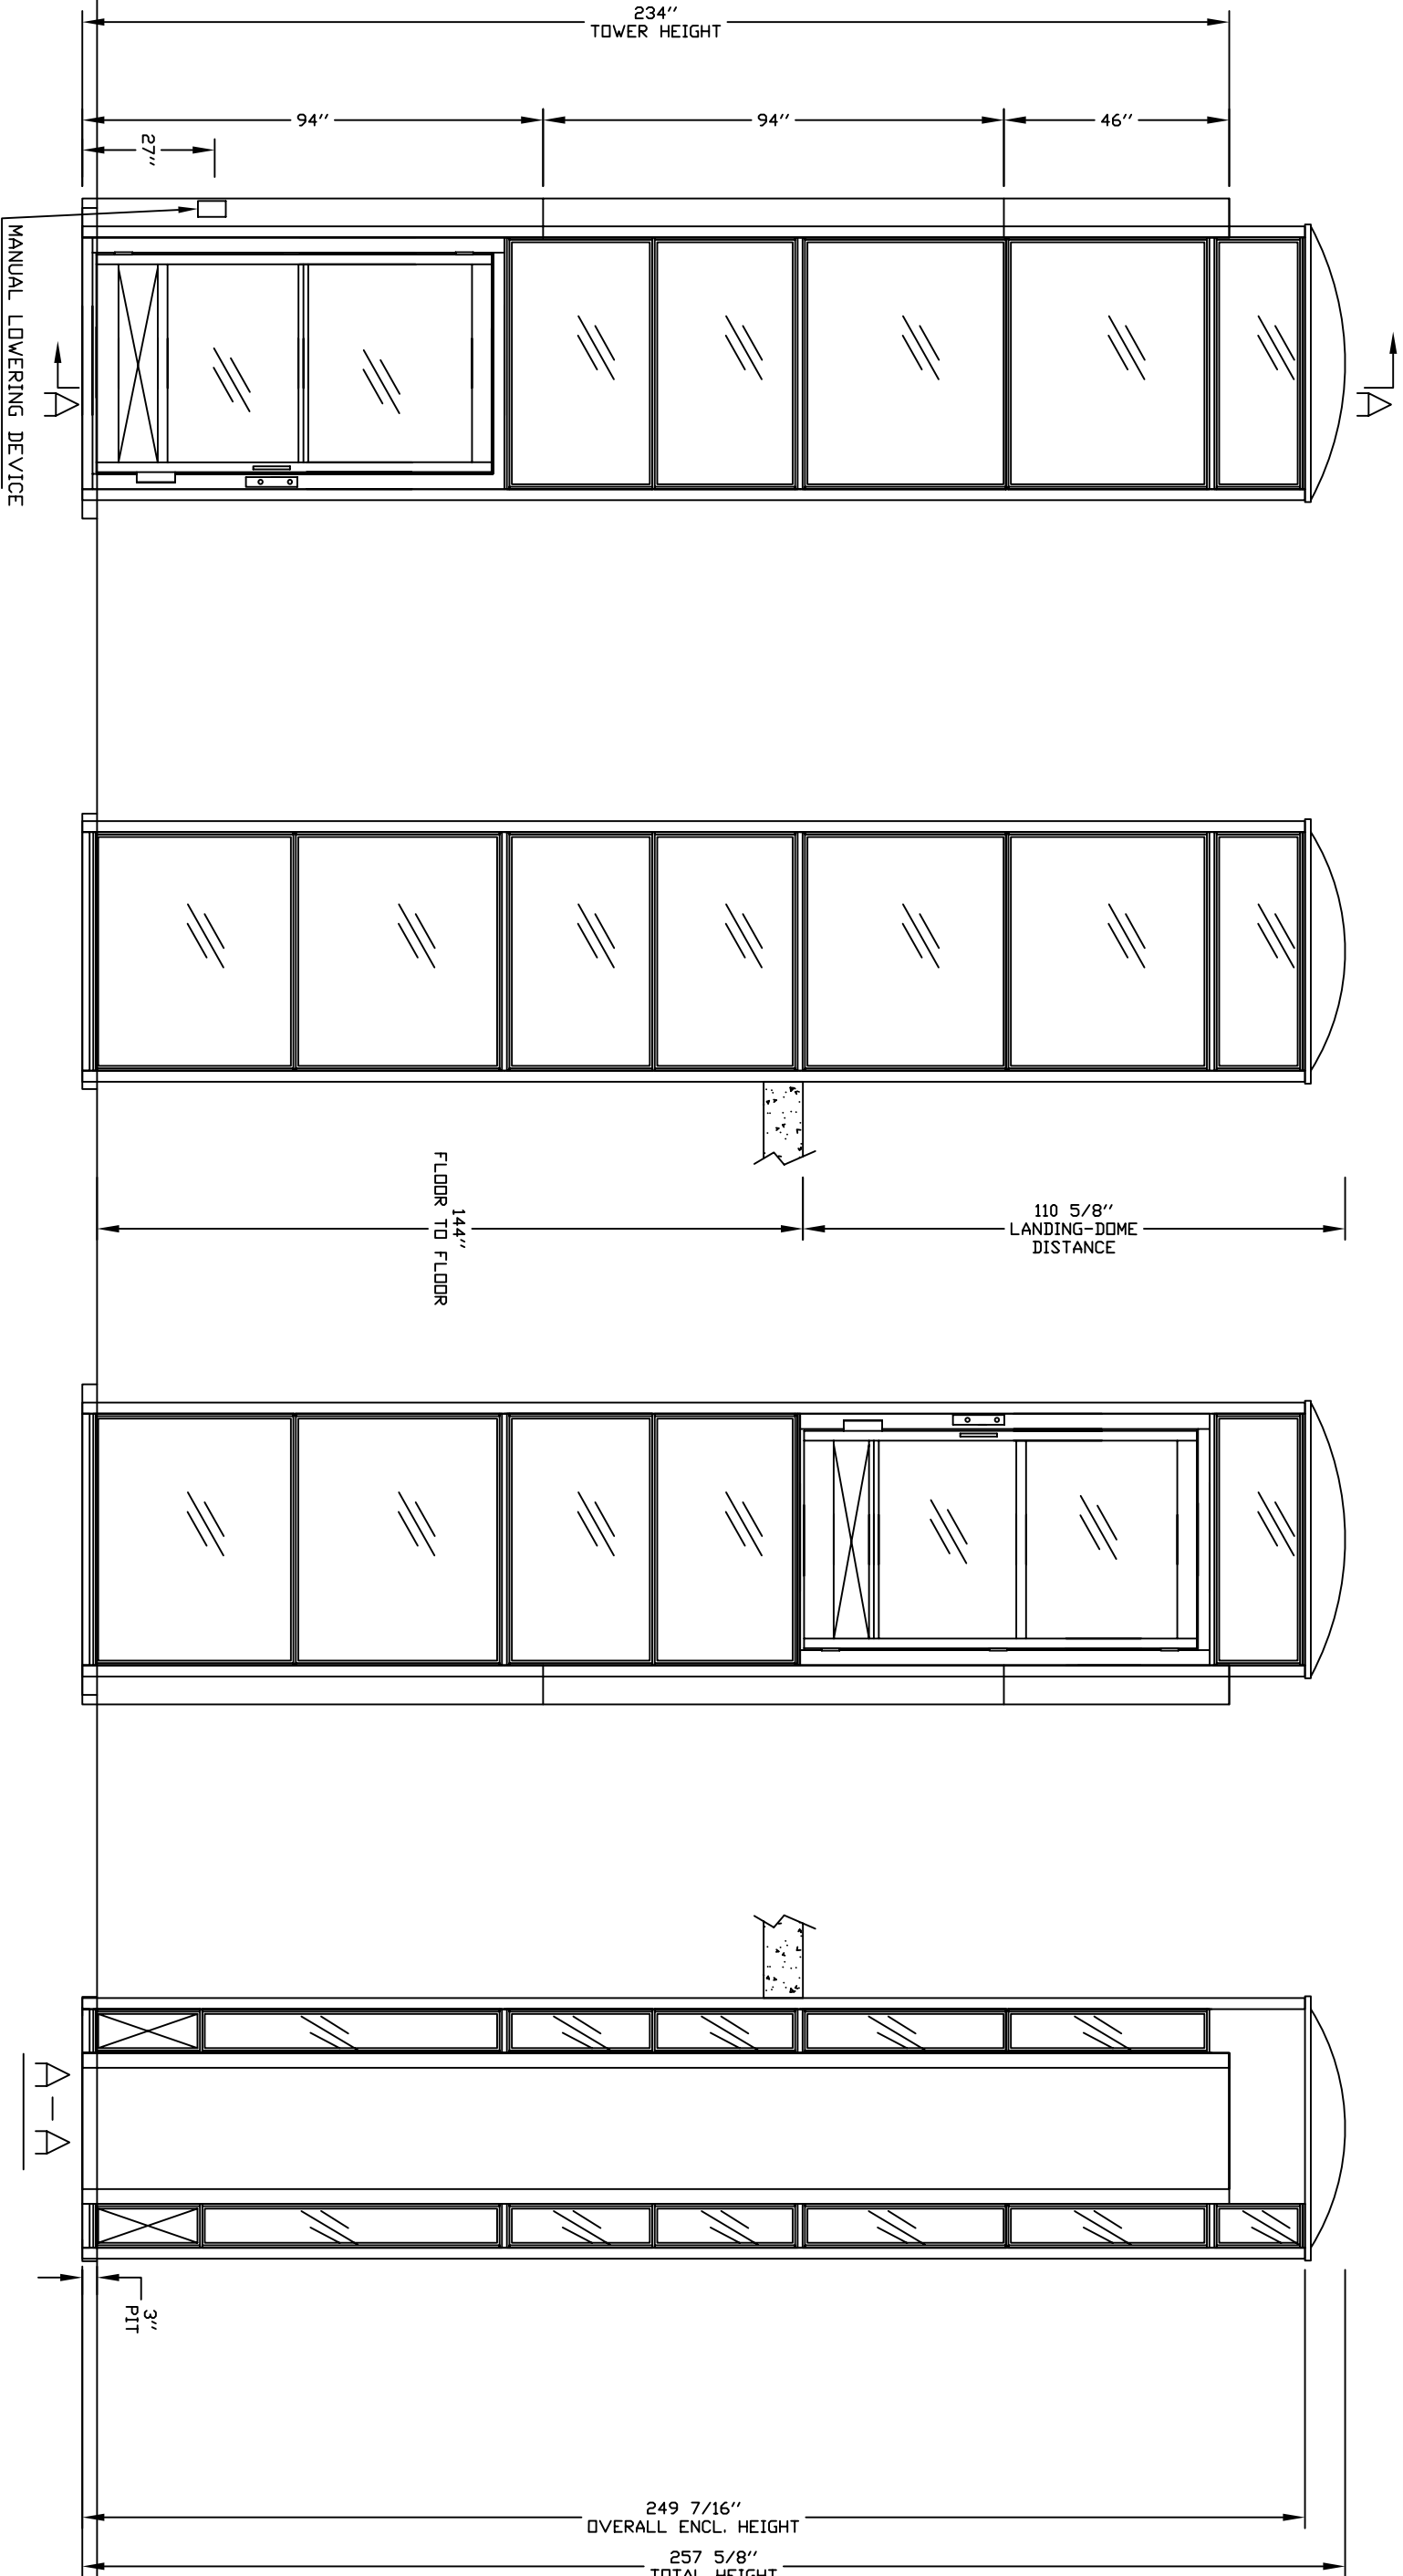

MANUAL LOWERING DEVICE

A

A-A

3" PIT

INSERT
STYLE: Door and Gate



SHEET METAL

INSERT
STYLE: Enclosure



SHEET METAL



Clear Plexiglass



Clear Plexiglass

ELEVATION VIEWS




ENCLOSED VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER: NATIONWIDE LIFTS
PROJECT: APEX COMPLETE - 42 WIDE X 48 DEEP
ADDRESS: DOORS OPPOSITE SIDES, RAILS ON LEFT
888-323-8755 INFO@ELEVATORS.COM

OFFICE USE ONLY:	
CONFIGURATION VERSION STAMP:	0.0
MODULE VERSION STAMP:	13/7/13

DATE: 06/16/15
REASON DATE: 06/16/15
COMPLETED BY: ANTHONY LIFTS

Port No.	48571	www.nationwide.com
Variant No.	48571	
Job No.	P000000	SHEET No. 3 OF 4
savaria		18

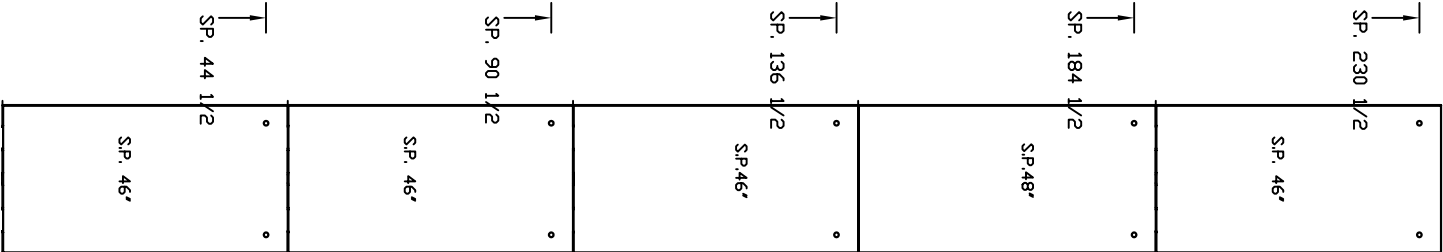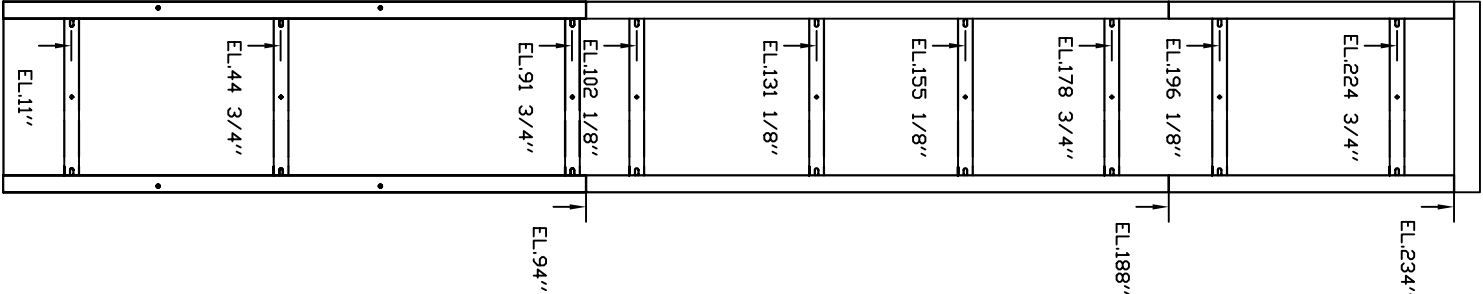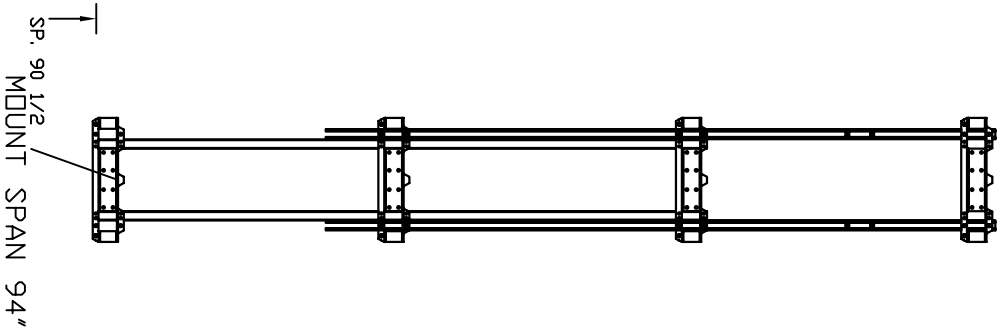

EL: MOUNTING BRACKET POSITION

SP: SERVICE PANEL

OFFICE USE ONLY:
CONFIGURATION VERSION STAMP: 0.0
MODULE VERSION STAMP: B37A13

CUSTOMER:	NATIONWIDE LIFTS
PROJECT:	APEX COMPLETE - 42 WIDE X 48 DEEP
ADDRESS:	DOORS OPPOSITE SIDES, RAILS ON LEFT
	888-323-8755 INFO@ELEVATORS.COM
DATE:	06/16/15
PERSON DATE:	06/16/15
COMPLETED BY:	ANDREW LIFTS

ELEVATION VIEWS

ENCLOSED VERTICAL WHEELCHAIR PLATFORM LIFT

Port No.		Nationwide Lifts
www.elevators.com		
Variant No.	48571	
SHEET No.	4 OF 4	

