
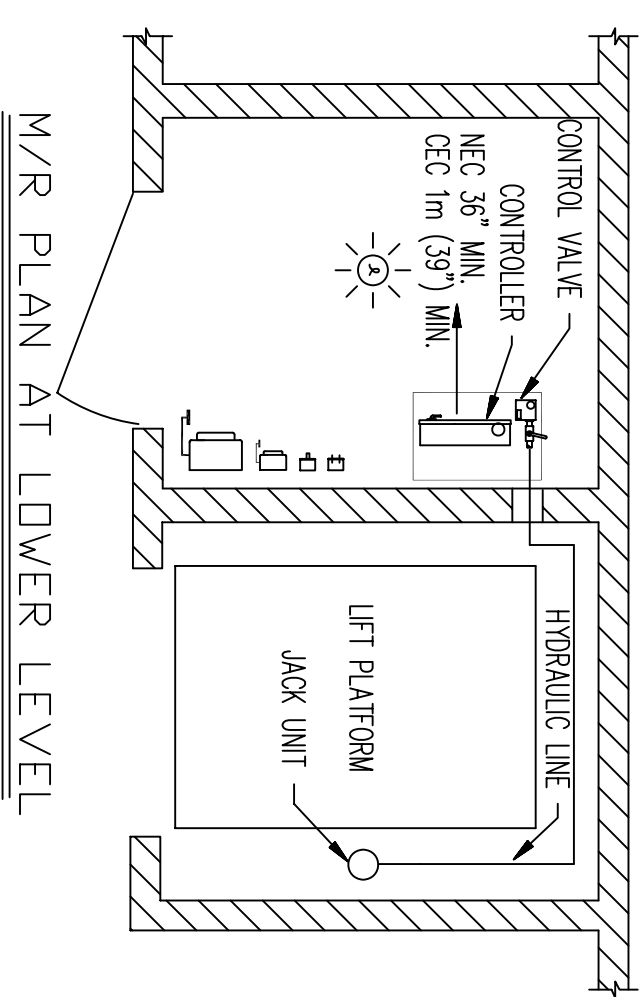


PLEASE NOTE:
 - OVERALL HOISTWAY LENGTH AND WIDTH DIMENSIONS ARE FROM DRYWALL TO DRYWALL (WHERE APPLICABLE)
 - CAB WITH LIGHT SCREEN

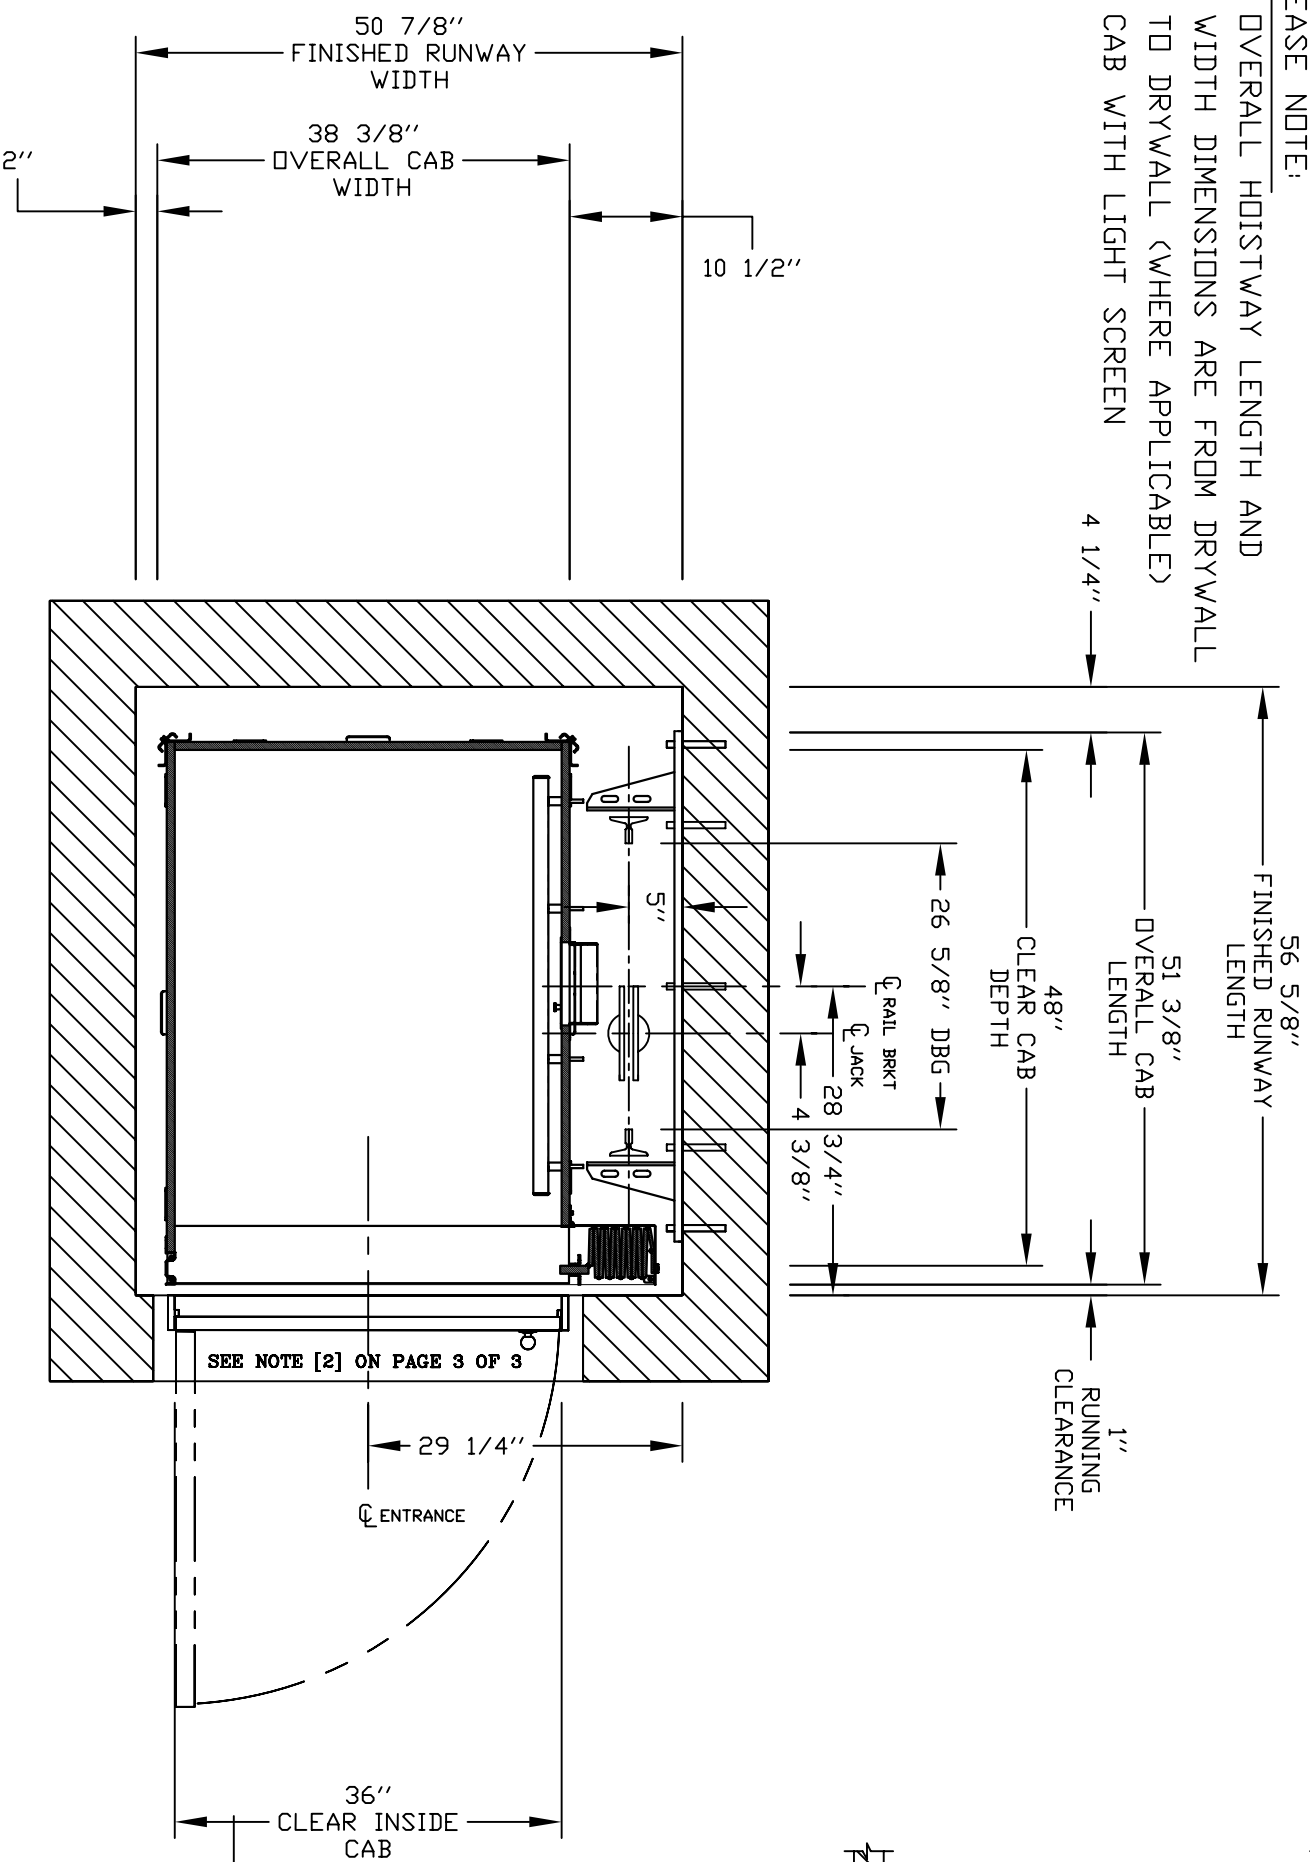

PRELIMINARY DRAWING ONLY
 DRAWING APPROVAL:

THIS DRAWING REFLECTS OUR INTERPRETATION OF THE INFORMATION PROVIDED BY THE DEALER ON THE ORDER FORM. THIS INFORMATION IS THE DEALER'S RESPONSIBILITY, AND IS THE BASIS FROM WHICH THIS LIFT IS DESIGNED AND MANUFACTURED. PLEASE INDICATE THE REQUESTED ACTION BY CHECKING ONE OF THE FOLLOWING BOXES AND SIGNING BELOW TO AUTHORIZE COMPLETION OF THIS ORDER.

- APPROVED WITH NO EXCEPTIONS
- MANUFACTURE PRODUCT AS PER DRAWING
- APPROVED WITH EXCEPTIONS, NO REAPPROVAL REQUIRED
- MAKE CHANGES AS NOTED, NO REAPPROVAL DRAWING REQUIRED
- CHANGE AS NOTED, REAPPROVAL REQUIRED
- MAKE CHANGES AS NOTED, SEND CORRECTED DRAWING FOR REAPPROVAL BEFORE MANUFACTURE

SIGNATURE: _____ DATE: _____
 CHANGES REQUEST:

1. _____
 2. _____
 3. _____
 4. _____
- CAUTION: ONCE THE DRAWING IS APPROVED, JOB CANCELLATION FEES WILL APPLY


PLAN VIEW

CUSTOMER: **TI ON W I D E L I F T S**
 PROJECT: Freedom Hydro - 36 wide x 48 deep
 ADDRESS: Doors Same Side, Rails on Right
 888-323-8755 info@elevators.com

| | |
|----------------------------------|-------------------|
| OFFICE USE ONLY: | Part No. |
| CONFIGURATION VERSION STAMP: 0.0 | Variant No. 48546 |
| MODULE VERSION STAMP: 15-633 | |
| DATE: 06/16/15 | |
| REVISION DATE: 06/16/15 | |
| COMPLETED BY: [Signature] | |

www.elevators.com

 JOB No. P-00000011 SHEET No. 3

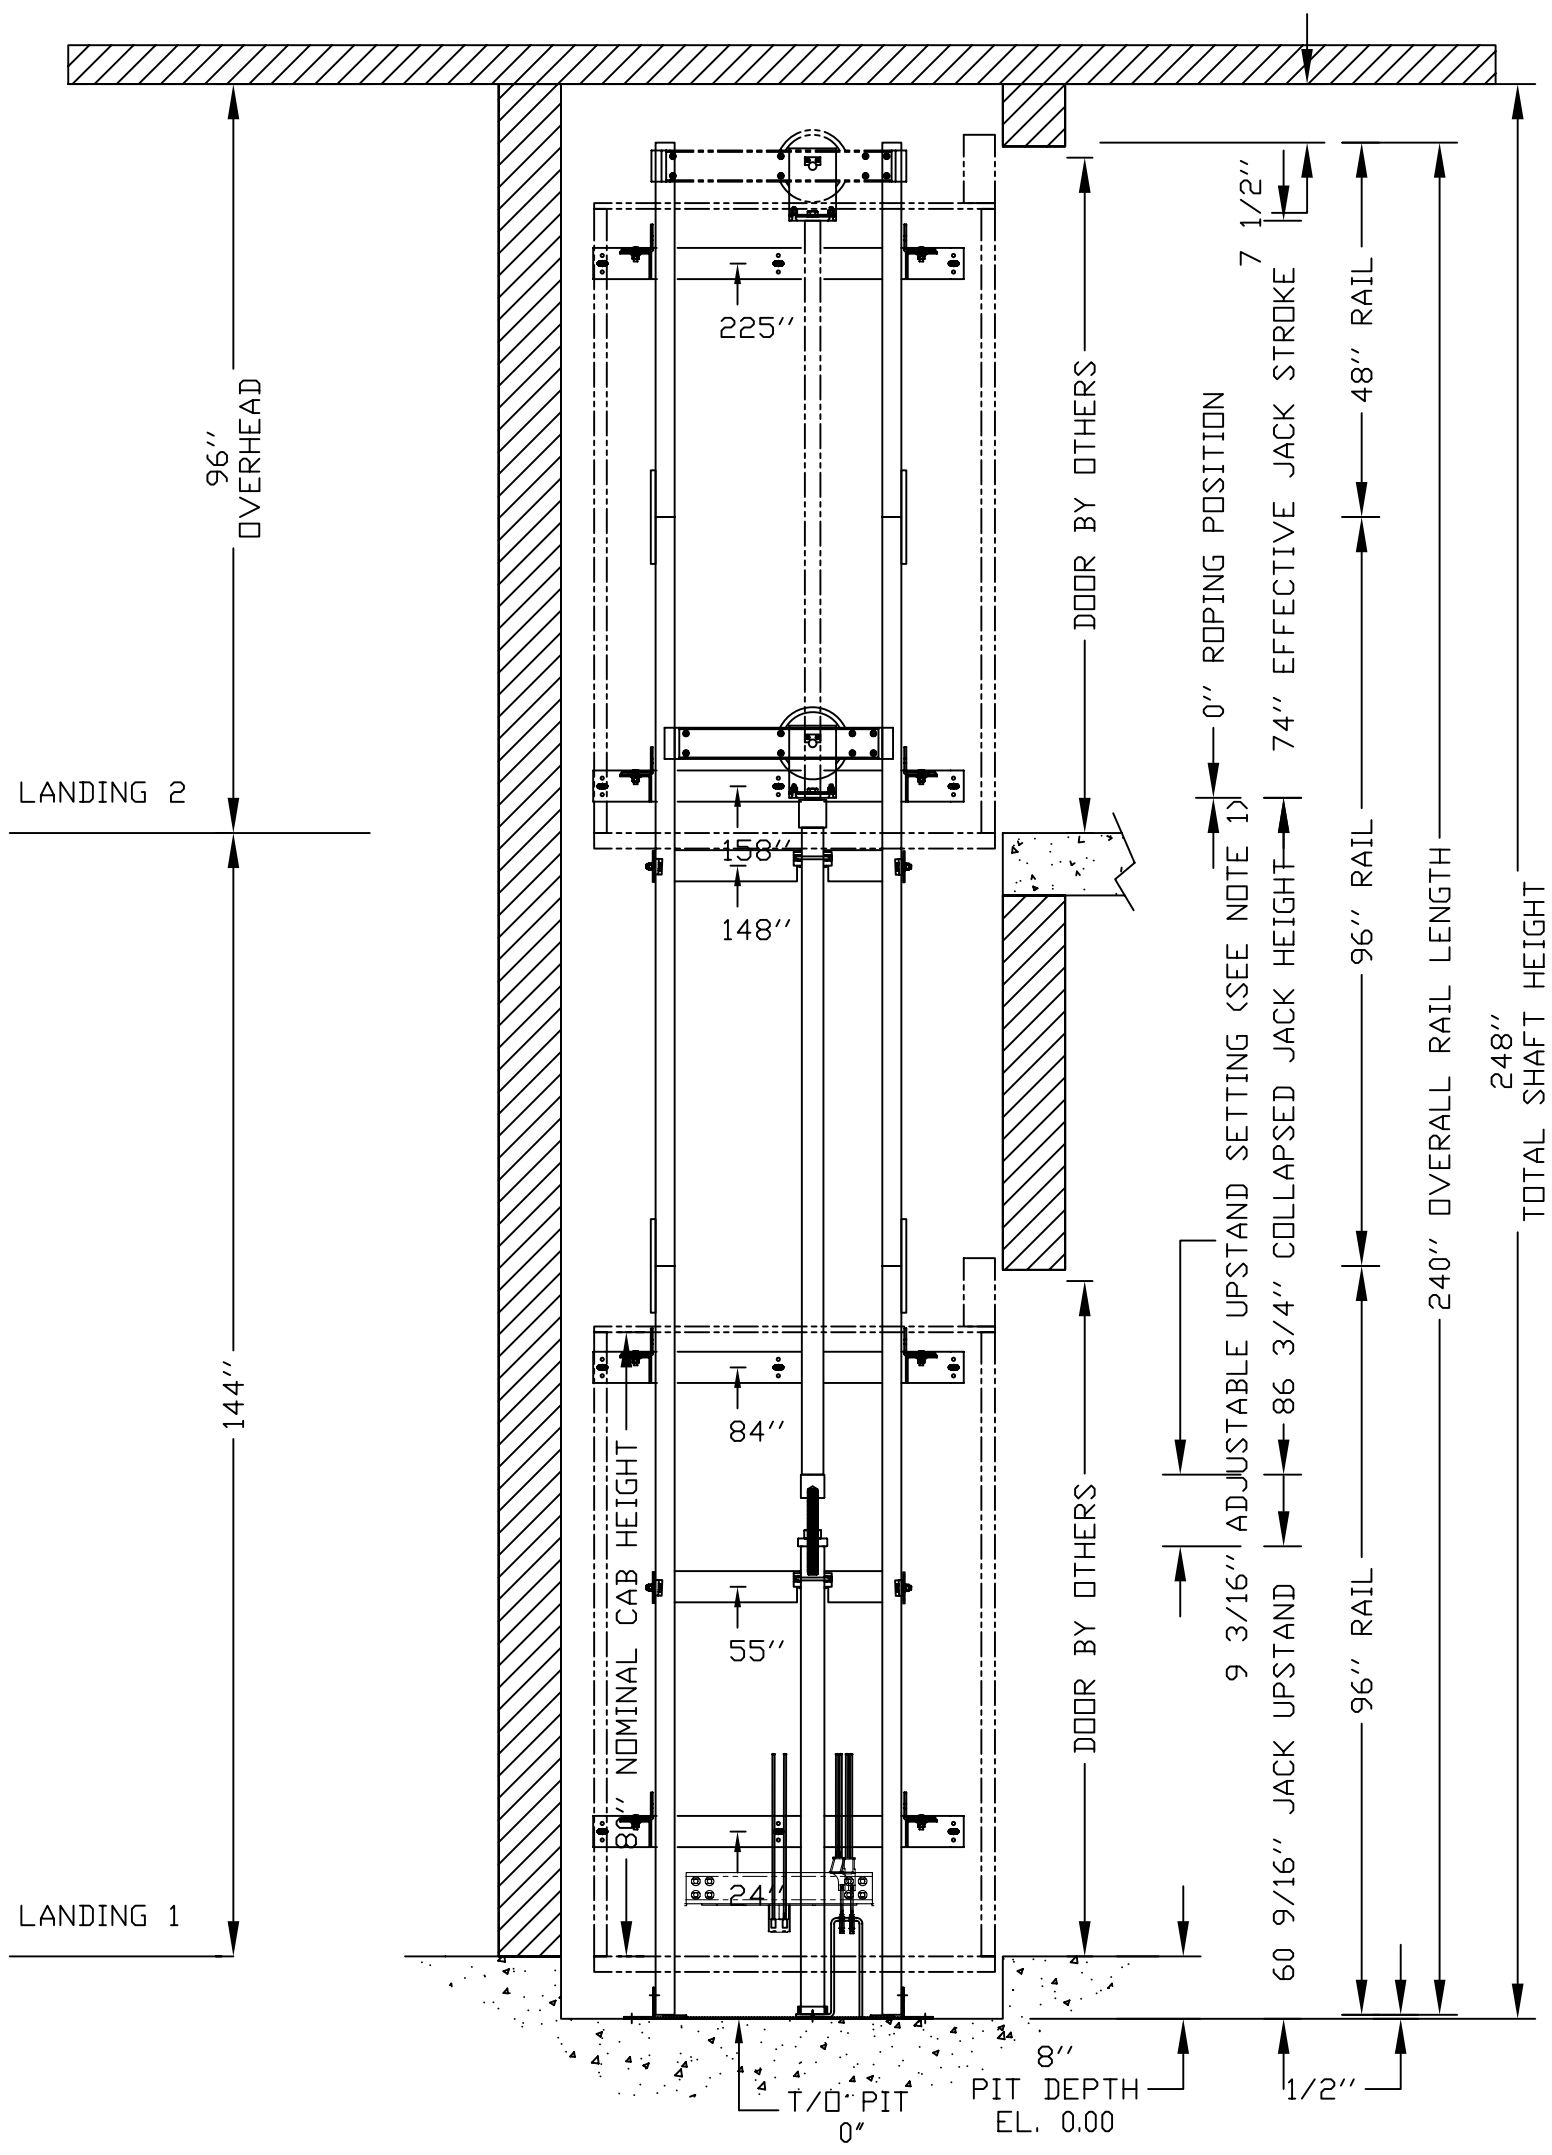



ELEVATION VIEW B-B

CUSTOMER: **NATIONWIDE LIFTS**
 PROJECT: Freedom Hydro - 36 wide x 48 deep
 ADDRESS: Doors Same Side, Rails on Right
 888-323-8755 info@elevators.com

DATE: 06/16/15
 REVISION DATE: 06/16/15
 COMPLETED BY: andy.dornley@nlifts.com

OFFICE USE ONLY:
 CONFIGURATION VERSION STAMP: 0.0
 MODULE VERSION STAMP: I-S-6.33

| | |
|---|----------|
| Part No. | |
| Variant No. | 48546 |
|  www.elevators.com | |
|  | |
| JOB No. | P-000000 |
| SHEET No. | 2 OF 3 |

PROVISIONS BY OTHERS

*GENERAL

HOISTWAY- THE HOISTWAY MUST BE IN ACCORDANCE WITH NATIONAL US/ASME (SEE APPLIED CODE), ALL STATE AND LOCAL CODES.

PLUMB HOISTWAY- DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.

MINIMUM OVERHEAD CLEARANCE- OWNER/AGENT MUST ENSURE MINIMUM OVERHEAD CLEARANCE IS IN COMPLIANCE WITH CODES.

CONSTRUCTION SITE- OWNER/AGENT TO PROVIDE ALL MASONRY, CARPENTRY AND DRYWALL WORK AS REQUIRED AND SHALL PATCH AND MAKE GOOD (INCLUDING FINISH PAINTING) ALL AREAS WHERE WALLS/FLOORS MAY REQUIRE TO BE CUT, DRILLED OR ALTERED IN ANY WAY TO PERMIT THE PROPER INSTALLATION OF THE LIFT. DIMENSIONS.

CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

*STRUCTURAL

FLOOR/SUPPORT WALL LOADS- CONTRACTOR TO ASSURE THAT BUILDING AND SHAFT WILL SAFELY SUPPORT ALL LOADS IMPOSED BY THE LIFT EQUIPMENT. REFER TO THE TABLES ON THIS DRAWING FOR LOADS IMPOSED BY THE EQUIPMENT.

DOORS- SUITABLE LINTELS MUST BE PROVIDED BY OWNER/AGENT. DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS. ALL FULL HEIGHT DOORS MUST BE ALIGNED WITH THE DOOR CENTER LINE. DOOR WITH THE CORE IS BETTER THAN THE HOLLOW DOOR.

NOTICE(2)- CLEARANCES FROM DOOR SILL TO HOISTWAY DOOR TO BE 3" (76mm) MAXIMUM AND ELEVATOR CAR DOOR TO HOISTWAY DOOR TO BE 5" (127mm) MAXIMUM TO COMPLY WITH CSA B44 (ASME/ANSI A17.1). CONSULT YOUR LOCAL INSPECTION AUTHORITIES FOR CODES WHICH MAY TAKE PRECEDENCE. N/A WITH SLIM AND FLUSH DOORS.

ENTRANCE ASSEMBLIES- ENTRANCE ASSEMBLIES MUST BE ADJUSTED TO ALIGN WITH PLATFORM AND INTERLOCK EQUIPMENT. OTHERS TO ALLOW AN ADEQUATE ROUGH OPENING.

RETURN WALLS- RETURN WALLS AT ENTRANCES MUST BE BUILT-IN BY OTHERS AFTER ENTRANCE ASSEMBLIES ARE IN PLACE. ENTRANCE ASSEMBLY MUST BE SECURELY FASTENED TO WALLS BY ELEVATOR CONTRACTOR.

*MACHINE ROOM

LOCATION / ACCESS- MACHINE ROOM LOCATED AT THE LOWEST LEVEL ADJACENT TO HOISTWAY, UNLESS SHOWN OTHERWISE ON THE LAYOUT DRAWINGS. FIELD ADJUSTMENT BY INSTALLER MAY BE NECESSARY TO MEET JOB SITE CONDITIONS OR REGULATIONS. MACHINE ROOM DOOR IS TO BE LOCKABLE AND IS TO MEET THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION. SLEEVES FOR OIL & ELECTRIC LINES- FROM MACHINE ROOM TO RUNWAY AS REQUIRED. (POSITION PER INSTALLERS INSTRUCTIONS).

| DISCONNECT SIZE | TIME DELAY | FUSE SIZE | VOLTS | PHASE | AMPERAGE |
|-----------------|------------|-----------|----------|--------------|----------|
| MOTOR & EQUIP | 30 AMPS | 30 AMPS | 230 volt | Single Phase | 159 AMPS |
| CAB LIGHTS | 15 AMPS | 15 AMPS | 115 V | 1 | |

*ELECTRICAL

POWER SUPPLY- (SEE SPECIFICATIONS) LOCKABLE FUSED DISCONNECT WITH AUXILIARY CONTACT TO BRAKE THE BATTERY FEED, OR CIRCUIT BREAKERS WITH A 3-POLE BREAKER FOR BATTERY FEED REQUIRED, IN COMPLIANCE WITH ELECTRICAL CODE, AS FOLLOWS:

LOCATED ON WALL ON LOCK JAMB SIDE OF MACHINE ROOM DOOR PERMANENT POWER- BEFORE INSTALLATION CAN BEGIN, PERMANENT

LIGHTING- THE ILLUMINATION SHALL BE NOT LESS THAN 200 LX (19 FC) AT THE FLOOR LEVEL IN ALL MACHINE ROOMS AND MACHINERY SPACES. ENSURE AT LEAST 100 LX (10 FC) AMBIENT LIGHTING OVER LIFT AREA.

PHONE- NEED A PHONE LAND LINE (NOT VOIP) FOR THE PHONE, WHERE APPLICABLE. FOR VOIP PLEASE CONTACT SAVARIA.

*ENTRANCES



FASCIA PANEL BELOW UPPER LEVEL ENTRANCE- WHERE REQUIRED, FASCIA PANEL MUST BE FASTENED TO A SOLID WALL AND BE PERPENDICULAR TO THE FLOOR AND WALLS. HOISTWAY FASCIA IS NOT SELF-SUPPORTING FOR LONG, CONTINUOUS RUNS VOID OF ENTRANCES. ADEQUATE SUPPORT FOR THE FASCIA MUST BE PROVIDED.

GENERAL

CLASSIFICATION: Residential Building
APPLIED CODE: ASME 17.1-2010 SEC. 5.3
MODEL: Infinity
CAPACITY: 1000lbs
NOMINAL SPEED: 36 fpm UP AND DOWN
TRAVEL: 144" [3.66 m]
PIT DEPTH: 8"
POWER SUPPLY: 60 Hz Single Phase 230 volt

HYDRAULIC

PUMP MFR.: CONCORD
PUMP MODEL: VICKERS 2P
MOTOR: 3.0 hp FROM NIDEC
VALVE MODEL NO.: EPV - 4
VALVE COIL VOLTS: 24 V DC
MAX WORKING PRESSURE: 1600 psi (11032 kPa)
RELIEF VALVE SETTING: MAX 25% ABOVE ACTUAL WORKING PRESSURE
RESERVOIR: 22 Gal.

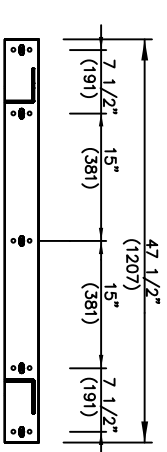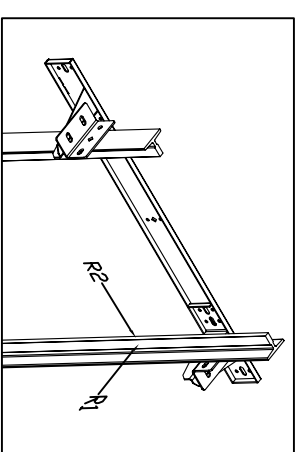

FIRST DOOR BY LANDING CHART

| DOOR TYPE | LANDING 1 | LANDING 2 |
|----------------------|-----------------|-----------------|
| ENTRANCE SIDE | Doors By Others | Doors By Others |
| DOOR SWING | Side C | Side C |
| LOCK TYPE | Right Hand | Right Hand |
| AUTO DOOR OPENER | Honeywell | Honeywell |
| HALL CALL KEY SWITCH | 1 | 2 |

RAIL BRACKET

| RAIL FORCES | R3 NOTE: |
|---------------------------|--|
| *R1 | PIT FLOOR TO SUPPORT LOAD OF: 6.4 kips *(INCLUDES IMPACT) |
| *R2 | |
| 304 lbf | |
| 194 lbf | |
| RAIL WEIGHT : 80 lbs / ft | |

FOR TOTAL PULL-OUT FORCE ON RAIL BRACKET, R1 MUST BE DOUBLED eg. 2 x 304 = 608 lbf

SPECIFICATIONS

CAR FINISH DETAILS

CAB PANEL SELECTION: To Be Determine
HARDWOOD FINISHES: Not applicable
CEILING SELECTION: standard (white)
BRASS CAB PKG REQ'D?: LED Pot Light
POT LIGHT FINISH: Stainless Steel
TRIM COLOUR: Clear Anodized Aluminum
CAR STATION PLATE: Clear Anodized Aluminum
HAND RAIL TYPE: Clear Anodized Aluminum
CAB FLOORING: Plywood Floor 3/4"
FINISHED FLOOR THICKNESS: 3/4" finish
TELEPHONE CABINET: no

CAR DIMENSIONS/PLATFORM GATES

CAB TYPE: Type 1 Right Hand
CAB OPERATION: auto
GATES REQUIRED: Manual Gates(s)
GATE TYPE: Panel Fold/Clear/WhT 3 Plexi
GATE FINISH: Gate Finish : Standard Hinges w Light Screen
LANDING DOOR FINISH: N/A

JACK UNIT


EFFECTIVE STROKE: 74"
PLUNGER O/D: 2"
CYLINDER O/D: 2 3/4"
CYLINDER I/D: 2 1/4"
SPLIT CYLINDER?: no
COLLAPSED LENGTH: 86 3/4"

SUSPENSION

TYPE: AIRCRAFT CABLE 2 X 3/8" DIA. RATIO 1:2
CONSTRUCTION: IWRC 7 X 19
NOMINAL STRENGTH: 14,400 lbs Per Cable
SPECS: MIL-83420
SAFETIES: TYPE A
OPTIONS

PHONE: Standard Phone Provided
TRAVELING CABLE: Flat Traveling Cable
LED POT LIGHT: LED Pot Light

ENTRANCE SIDE LEGEND

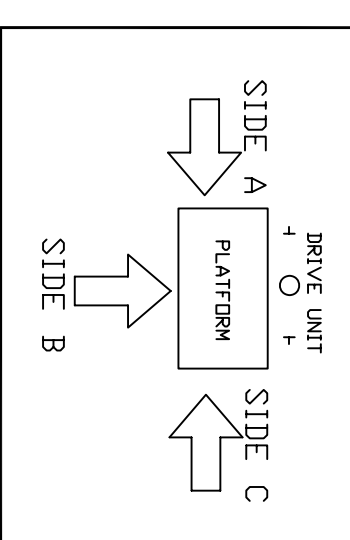

| OFFICE USE ONLY: |
|------------------------------------|
| CONFIGURATION VERSION STAMP: 0.1.0 |
| MODULE VERSION STAMP: 1-S-633 |

Port No. 48546

Variant No. 48546

Nationwide Lifts
 www.elevators.com

Savaria™

Job No. P-0000003
 SHEET No. 3

DATA SHEET

CUSTOMER: NATIONWIDE LIFTS
PROJECT: Freedom Hydro - 36 wide x 48 deep
ADDRESS: Doors Same Side, Rails on Right
 888-323-8755 info@elevators.com

DATE: 06/16/15
REVISION DATE: 06/16/15
COMPLETED BY: [Signature]
DATE: [Signature]